




# Wall mounted boilers

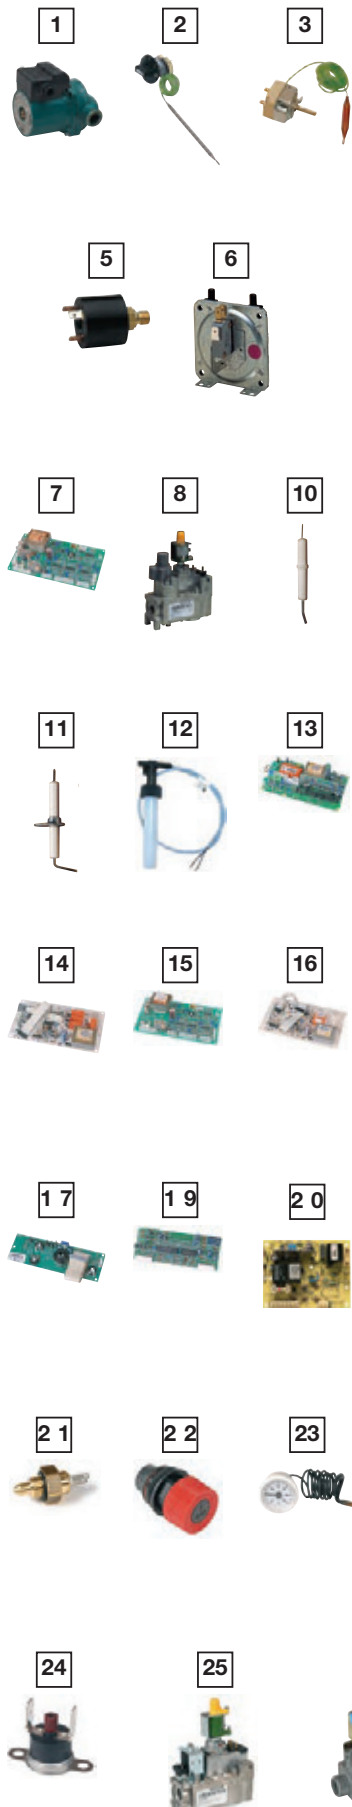

Position	Description	Reference
1	Circulator 20-70 6H (CM-CMV) before 2004	WUN02384
	Circulator (from 2004)	WUN03619
2	Pool regulation thermostat (model 93 to 94) bulb 6	WEG01405
3	Pool regulation thermostat (since 95) bulb 10	WEG01404
5	No water pressure switch (before 2004)	WUN02441
6	Smoke safety pressure switch (CMV 24)	WUN02432
7	Electronic plate (CMV24) before 2002	WUN02411
8	Gas vane piezo lighting V 4600 N	WUN02424
10	Piezo starter electrode	WUN02394
11	Starter/ionisation electrode	WUN02436
12	Noryl flow switch	WSK02022
13	Electric plate CMV from 2004	WUN03608
14	Electric plate (CMV) from 2002	WUN03041
15	Electronic plate (CM24) before 2002	WUN02410
16	Electric plate (CM) from 2002	WUN03061
17	Command plate (CMV) from 2004	WUN03606
	Electric plate (CM - CMV) from 2002	WUN03040
19	Lighter plate (CMV) from 2004	WUN03607
20	Electronic lighter plate	WUN02409
21	Primary circuit sensor (before 2004)	WUN02433
22	Safety valve head	WUN02420
23	Primary circuit thermometer for facade	WUN02440
24	Smoke safety thermostat (CM)	WUN02414
25	Electronic lighting gas vane (605 N VR4605N)	WUN02425
26	Gas vane CMV from 2004 (845 SIGMA)	WUN03605
27	Pilot + support (CM)	WUN02417
	Pilot + support (CMV)	WUN02418
28	Primary circuit sensor (before 2004)	WUN03616
29	Lighter transformer (from 2004)	WUN03620
31	Primary circuit water manometer for facade	WUN02434
	90° concentric angle Ø 100	WUN02388
	1m concentric extension Ø 100	WUN02415
	Safety Klixon 105° C AE (before 2004)	WUN03060
	Safety Klixon 105° C for pilot	WUN02404
	Ventilator motor (CMV24)	WUN03062
	Protection basket	WUN02442
	Safety Klixon 105°C (before 2004)	WUN03618
	Automatic purger	WUN02438
	Relay (CMV 24)	WCF02710
	Thermocouple	WUN02422
	No water pressure switch (from 2004)	WUN03617
	Boiler tank (give the model type)	W49CUVE40KT
	Pool temperature sensor (from 2004)	WUN03610